



CLEARVIEW  
TOWNSHIP



# Stayner 2024 Drinking Water Compliance Report

Period Covering: January 1 to December 31, 2024

---

Annual and Municipal Summary Reports

(Prepared in accordance with Section 11 and Schedule 22 of Ontario Regulation 170/03)

# TABLE OF CONTENTS

INTRODUCTION _____	4
Drinking Water System Information _____	4
Report Content _____	4
Report Format _____	5
Report Availability _____	5
QUALITY MANAGEMENT SYSTEM _____	6
Quality Management System Policy _____	6
Quality Management System Summary _____	6
STAYNER DRINKING WATER SYSTEM _____	8
System Description _____	8
Water Treatment Chemicals _____	8
Major Expenses Incurred within the Drinking Water System _____	9
OPERATIONAL CHECKS, SAMPLING AND TESTING _____	9
Operational Checks _____	9
Table 1: Schedule 7 Operational Checks Summary _____	9
Microbiological Testing _____	10
Table 2: Schedule 10 Microbiological Testing Results _____	10
Chemical Testing _____	10
Table 3: Chemical Sampling Frequency _____	10
Table 4: Trihalomethanes (THMs) and Haloacetic Acids (HAAs) _____	11
Table 5: Nitrite and Nitrate _____	11
Table 6: Sodium and Fluoride _____	11
Table 7: Schedule 23 - Inorganics _____	11
Table 8: Schedule 24 – Organics _____	12
Table 9: Other Sampling Conducted Outside O. Reg. 170/03 _____	13
Community Lead Testing Program _____	13
Table 10: Schedule 15.1 - Lead _____	14
Adverse Water Quality Incidents _____	14
REGULATORY COMPLIANCE SUMMARY _____	15

Safe Drinking Water Act & Associated Regulations	15
Municipal Drinking Water Licence & Drinking Water Works Permit	15
Permit to Take Water	15
Provincial Orders	15
SYSTEM CAPACITY	16
Allowable Capacities	16
Table 11: Allowable Capacities	16
2024 Flow Summary	16
Figure 1: Monthly Flow Totals	16
Table 12: Monthly Flows	17
Figure 2: System Capacity	17
Figure 3: 2024 Daily Flows	18
Figure 4: Five-year Total Flow Comparison	19

# INTRODUCTION

This report has been prepared by the Township of Clearview to satisfy the requirements of Section 11: Annual Report and Schedule 22: Summary Reports for Municipalities of Ontario Regulation 170/03 (O. Reg 170/03).

The report covers the period from January 1 to December 31, 2024, for the following municipally owned and operated drinking water system:

- Stayner Drinking Water System

## Drinking Water System Information

Drinking Water System Number:	220001138
Drinking Water System Category:	Large Municipal Residential
Drinking Water System Classification:	Water Supply and Distribution Class 2
Municipal Drinking Water Licence Number:	099-106, Issued June 25, 2020
Drinking Water Works Permit Number:	099-206, Issued June 25, 2020
Permit to Take Water:	P-300-6059698529, Issued June 11, 2020

## Report Content

Under Section 11 of O. Reg 170/03, the Owner of a drinking water system is required to prepare an annual report covering the period of January 1 to December 31 by February 28<sup>th</sup> of the following year.

The annual report must contain the following information:

- A brief description of the drinking water system, including a list of water treatment chemicals used.
- A summary of any reports made to the Ministry of Environment, Conservation and Parks (MECP) pertaining to Adverse Water Quality Incidents (AWQI).
- A summary of test results required under O. Reg. 170/03, or by an approval, the municipal drinking water licence or an order, including an Ontario Water Resources Act order, if tests were not required during this period, a summary of the most recent test results.
- A description of corrective actions taken in accordance with Schedule 17 or 18 of O. Reg. 170/03.
- A description of any major expenses incurred to install, repair or replaced required equipment.
- A statement of where a report prepared under Schedule 22 will be available for inspection by the public, without charge.

Schedule 22 of O. Reg 170/03 requires that an Annual Summary Report for Municipalities be provided to Council by March 31<sup>st</sup> each year. The report summarizes at a high level, the regulatory activity of the drinking water system for the preceding year. It must contain the following information:

- List of requirements of the Act, regulations, the system's approval, drinking water works permit, municipal drinking water licence, and any orders applicable to the system that were not met at any time during the period covered by the report and specify the duration of the failure and describe the measures taken to correct the failure.
- A summary of quantities and flow rates of the water supplied during the period covered by the report, including monthly average and maximum daily flows.
- A comparison of the summary of quantities and flow rates to the rated capacity and flow rates approved in the system's approval, drinking water works permit or municipal drinking water licence.

## Report Format

This report provides details on measures taken by staff to ensure compliance with Terms and Conditions of the control documents, Act, Regulations, or any orders the system may have been under during the reporting period.

Rated capacities and flows approved in the system's certificates are summarized. There are discrepancies between the capacities allowed in some control documents. Exceeding the Drinking Water Licence or Permit to Take Water flow rates can be considered a contravention of legislation. For this reason, we strive to keep the flow rates below the lower of the control document limits.

A summary of quantities and flow rates including monthly averages and maximum daily flows are included. This flow comparison is to allow for a basic overview of the system's performance and allows for review and planning of possible future expansions if required. The actual pumping capacity has been used to calculate the percentage of overall capacity because in some cases actual capacity has decreased over time and is not represented realistically by the system control documents.

## Report Availability

In accordance with Section 11 of O. Reg. 170/03, a copy of the report is available to the public, free of charge, at the following locations:

- Township of Clearview's website [www.clearview.ca](http://www.clearview.ca)

- By request at the Township Administration Building, located at 217 Gideon St., Stayner.
- By request at the Township Public Works Building, located at 5833 County Road 96, Stayner.

The public is advised of the report's availability, without charge, and how a copy may be obtained via local newspaper ads, the Township of Clearview's website and social media feeds by February 28<sup>th</sup>.

## QUALITY MANAGEMENT SYSTEM

### Quality Management System Policy

#### **Township of Clearview Water Department Quality Management System Policy Statement**

It is Clearview Township's aim to ensure safe drinking water to the end user within all Township - operated water systems. Through this policy the Township commits to follow all applicable legislation & regulations that are associated with the safety and the delivery of Drinking Water. Through maintenance and continual improvement to the Quality Management System the Township is identifying, measuring, controlling and improving the various core water works processes that will ultimately lead to improved water works performance.

### Quality Management System Summary

Clearview's Quality Management System (QMS) is legislated under the Drinking Water Quality Management Standard (DWQMS) through the Safe Drinking Water Act. It utilizes a set of coordinated activities to direct and control the department to continually improve the effectiveness of its performance.

The annual Management Review meeting was held to evaluate the continuing suitability, adequacy, and effectiveness of the QMS. The meeting occurred on March 22, 2024, and a subsequent report to council was prepared and submitted for information.

Internal audits were conducted by trained waterworks employees to ensure that the QMS conforms to the requirements of the Township's Operational Plan and the DWQMS. These requirements include ensuring that the QMS has been effectively implemented and properly maintained. The 2024 audit was conducted between February 22<sup>nd</sup> and February 27<sup>th</sup>, 2024. Six Opportunities for Improvement (OFI) were noted in the report.

Since 2012, Intertek - SAI Global has been retained to provide external auditing services of the DWQMS for Clearview. Having successfully passed a re-accreditation audit in 2023, a new external audit cycle began in 2024 with a 12 Month Surveillance Audit. The audit for the six drinking water systems was completed on March 25, 2024, with no OFIs or corrective action requirements being noted in the 11-page report. The purpose of this audit was to determine whether the drinking water QMS conforms to the requirements of the DWQMS Version 2, that it has been effectively implemented and maintained, and that accreditation can continue to be offered to the Township as the operating authority for the drinking water systems. The result was that The Corporation of the Township of Clearview's QMS is considered effectively implemented and meets all the requirements of the standard relative to the scope of certification and it was recommended that certification as an operating authority be continued. The current Certificate of Registration for conforming with the requirements of Drinking Water Quality Management Standard Version 2 – 2017 was issued to the Township on November 3, 2023 and is considered still valid.

The Safe Drinking Water Act and regulations call for water works owners to continually monitor water works performance, and review levels of treatment versus current standards. The public expects that responsible owners will be diligent in their duty to care for public water supplies.

Section 19 of the Safe Drinking Water Act (Standard of Care) became effective December 31, 2012. After election of a new Council, members are invited to attend a facilitated training session to understand their responsibilities under the Act. This was conducted at a Special Council Meeting on March 16, 2023, with the Walkerton Clean Water Centre presenting their Responsibilities Under the Statutory Standard of Care – Safe Drinking Water Act course.


The Township is well organized to manage the water works system. Further, staff have been proactive to ensure all necessary measures are taken to achieve compliance with Regulations and various control documents.

# STAYNER DRINKING WATER SYSTEM

## System Description

The Stayner Drinking Water System is in the middle of the Township of Clearview. There are three pumphouses between two sites, 297 Sunnidale Street, and 1485 County Road 42. The system also features an above ground reservoir at 1882 County Road 42.

The facilities are owned and operated by the Corporation of the Township of Clearview in accordance with the licence and permits issued by the Ontario Ministry of Environment, Conservation and Parks (MECP) and all other applicable legislation.

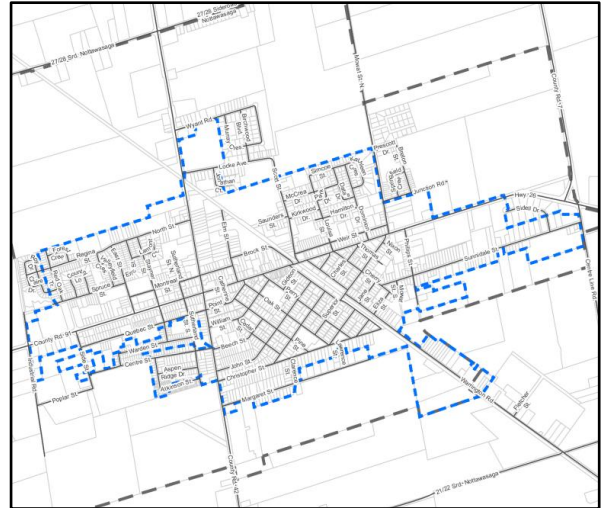

Source water for the Stayner drinking water system is provided by four groundwater wells. Water is drawn from the wells on the pumphouse property where it is treated with sodium hypochlorite for primary and secondary disinfection. ClearHib5, blended polyphosphate, is also added to the water for iron sequestering. The well pumps are used to convey the treated water to the two glass-lined steel above ground water storage tanks with a combined total capacity of approx. 7,100 m<sup>3</sup>. The reservoir provides system pressure from the elevation of the tanks and water storage for firefighting needs. The distribution system is comprised of approx. 51 km of various sized watermain, with 259 fire hydrants for fire protection. At the end of 2024, there were 2,070 active service connections, translating to an approx. population of 5,200 people.

A computerized Supervisory Control and Data Acquisition (SCADA) system is used to continuously monitor the drinking water system and alert a certified operator should it detect a potential problem. A 100 kW standby generator provides backup power to Pumphouse # 2 and its treatment equipment in the event of a power failure.

## Water Treatment Chemicals

Chemicals used for drinking water treatment include:

- 12% Sodium Hypochlorite
- ClearHib 5 polyphosphate

## Major Expenses Incurred within the Drinking Water System

- William St. and Pine St. valve replacements - \$10,000
- Sunnidale Street watermain replacement (municipal portion) - \$812,130
- Reservoir level probe replacement - \$1,400
- Well 1 flow meter - \$5,100
- SCADA and Historian computer upgrades - \$2,000

## OPERATIONAL CHECKS, SAMPLING AND TESTING

All operational checks and sampling were conducted at the required frequency and locations as per Schedule 6 of O. Reg. 170/03 during the reporting period. All samples were collected by certified operators and analysis performed by accredited laboratories. No additional testing and sampling were necessary due to any requirements of an approval, order, or other legal instrument.

### Operational Checks

Operational checks including, treated water and distribution water free chlorine residuals, as well as source water raw turbidity are required under Schedule 7 of O. Reg. 170/03. Raw water turbidity samples are collected and analyzed monthly from each production well. The free chlorine residual in the treated water leaving the pumphouse is continuously monitored by an online analyzer connected to the SCADA system for data logging and alarming. Grab samples from various locations in the distribution system are collected twice a week and analyzed for free chlorine. Table 1 below summarizes the results for the reporting period.

**Table 1: Schedule 7 Operational Checks Summary**

Parameter	Number of Samples	Min.	Max.	Unit
Raw Turbidity – Well # 1	12	0.35	0.90	NTU
Raw Turbidity – Well # 2	12	0.28	1.10	NTU
Raw Turbidity – Well # 3	12	0.51	1.11	NTU
Raw Turbidity – Well # 4	12	0.35	0.94	NTU
Treated Water Free Chlorine – Pumphouse # 1	8760*	0.31	1.87	mg/L
Treated Water Free Chlorine – Pumphouse # 2	8760*	0.64	3.11	mg/L
Treated Water Free Chlorine – Pumphouse # 3	8760*	0.30	1.84	mg/L
Distribution Water Free Chlorine	420	0.39	1.51	mg/L

\*8760 is the number used for continuous monitoring equipment.

## Microbiological Testing

Microbiological testing of raw source water and distribution water samples is required by Schedule 10 of O. Reg. 170/03 for large municipal residential drinking water systems. Raw water samples from each production well, a treated water sample and four distribution samples are collected on a weekly basis. Laboratory results for all samples analyzed for E. coli, Total Coliforms, Background and Heterotrophic Plate Count (HPC) met the requirements and did not exceed the applicable standards set out in O. Reg. 169/03. On rare occasions, untreated raw water samples indicated the presence of bacteria. Table 2 below summarizes the microbiological and bacteriological sample results for the reporting period.

**Table 2: Schedule 10 Microbiological Testing Results**

Sample Type / Source	Number of Samples	E.coli CFU/100 mL		Total Coliform CFU/100 mL		Number of HPC Samples	HPC CFU/100 mL	
		Min.	Max.	Min.	Max.		Min.	Max.
Raw – Well # 1	49	0	0	0	0	NR	-	-
Raw – Well # 2	50	0	0	0	2	NR	-	-
Raw – Well # 3	53	0	0	0	0	NR	-	-
Raw – Well # 4	53	0	0	0	0	NR	-	-
Treated – Well # 1	49	0	0	0	0	53	< 10	50
Treated – Well # 2/4	53	0	0	0	0	53	< 10	30
Treated – Well # 3	53	0	0	0	0	53	< 10	20
Distribution	212	0	0	0	0	53	< 10	30

## Chemical Testing

Testing performed under Schedule 13 of O. Reg. 170/03. The tables 4 through 8 below summarize the sample results for the reporting period or provide the most recent results if samples were not required to be collected during the reporting period. All sampling is of treated drinking water leaving the pumphouse, except for THM and HAA samples that are collected from the distribution system.

**Table 3: Chemical Sampling Frequency**

Parameter	Required Sampling Frequency
THMs	Every Calendar Quarter, calculated as running annual average
HAAs	Every Calendar Quarter, calculated as running annual average
Nitrite & Nitrate	Every 3 months

Sodium	Every 60 months
Fluoride	Every 60 months
Schedule 23 – Inorganics	Every 36 months
Schedule 24 - Organics	Every 36 months

ODWS MAC – Ontario Drinking Water Standard Maximum Allowable Concentration. Where two numbers are listed in this column the first is the aesthetic objective and the second is the maximum allowable under O. Reg. 169/03.

**Table 4: Trihalomethanes (THMs) and Haloacetic Acids (HAAs)**

Parameter	Running Annual Average	ODWS MAC	Unit	Exceedance
THMs	15.3	100	ug/L	No
HAAs	6.7	80	ug/L	No

**Table 5: Nitrite and Nitrate**

Parameter	Date Sampled	Result Well # 1	Result Well # 2/4	Result Well # 3	ODWS MAC	Unit	Exceedance
Nitrite	22 Jan 2024	< 0.003	< 0.003	< 0.003	1	mg/L	No
	16 Apr 2024	< 0.003	< 0.003	< 0.003	1	mg/L	No
	15 Jul 2024	< 0.003	< 0.003	< 0.003	1	mg/L	No
	21 Oct 2024	< 0.003	< 0.003	< 0.003	1	mg/L	No
Nitrate	22 Jan 2024	0.224	2.92	0.244	10	mg/L	No
	16 Apr 2024	0.452	6.80	0.173	10	mg/L	No
	15 Jul 2024	0.259	5.81	0.344	10	mg/L	No
	21 Oct 2024	0.428	9.12	0.339	10	mg/L	No

**Table 6: Sodium and Fluoride**

Parameter	Date Sampled	Result Well # 1	Result Well # 2/4	Result Well # 3	ODWS MAC	Unit	Exceedance
Sodium	9 Sept 2024	11.2	7.5	7.08	20, 200	mg/L	No
Fluoride	18 Jul 2022	< 0.1	< 0.1	< 0.1	1.5	mg/L	No

**Table 7: Schedule 23 - Inorganics**

Parameter	Date Sampled	Result Well # 1	Result Well # 2/4	Result Well # 3	ODWS MAC	Unit	Exceedance
Antimony	6 Dec 2022	< 0.0001	< 0.0001	0.0001	0.006	mg/L	No

Arsenic	6 Dec 2022	0.0005	0.0001	0.0006	0.01	mg/L	No
Barium	6 Dec 2022	0.077	0.042	0.072	1	mg/L	No
Boron	6 Dec 2022	0.019	0.010	0.020	5	mg/L	No
Cadmium	6 Dec 2022	< 0.000010	< 0.000010	0.000153	0.005	mg/L	No
Chromium	6 Dec 2022	< 0.002	< 0.002	< 0.002	0.05	mg/L	No
Mercury	6 Dec 2022	< 0.00002	< 0.00002	< 0.00002	0.001	mg/L	No
Selenium	6 Dec 2022	< 0.001	< 0.001	< 0.001	0.05	mg/L	No
Uranium	6 Dec 2022	0.00060	0.00084	0.00062	0.02	mg/L	No

**Table 8: Schedule 24 – Organics**

Parameter	Date Sampled	Result Well # 1	Result Well # 2/4	Result Well # 3	ODWS MAC	Unit	Exceedance
Alachlor	5 Feb 2024	< 0.02	< 0.02	< 0.02	5	ug/L	No
Atrazine + N-dealkylated metabolites	5 Feb 2024	< 0.01	< 0.01	< 0.01	5	ug/L	No
Azinphos-methyl	5 Feb 2024	< 0.05	< 0.05	< 0.05	20	ug/L	No
Benzene	5 Feb 2024	< 0.32	< 0.32	< 0.32	1	ug/L	No
Benzo(a)pyrene	5 Feb 2024	< 0.004	< 0.004	< 0.004	0.01	ug/L	No
Bromoxynil	5 Feb 2024	< 0.33	< 0.33	< 0.33	5	ug/L	No
Carbaryl	5 Feb 2024	< 0.05	< 0.05	< 0.05	90	ug/L	No
Carbofuran	5 Feb 2024	< 0.01	< 0.01	< 0.01	90	ug/L	No
Carbon Tetrachloride	5 Feb 2024	< 0.17	< 0.17	< 0.17	2	ug/L	No
Chlorpyrifos	5 Feb 2024	< 0.02	< 0.02	< 0.02	90	ug/L	No
Diazinon	5 Feb 2024	< 0.02	< 0.02	< 0.02	20	ug/L	No
Dicamba	5 Feb 2024	< 0.20	< 0.20	< 0.20	120	ug/L	No
Dichlorobenzene, 1,2-	5 Feb 2024	< 0.41	< 0.41	< 0.41	3, 200	ug/L	No
Dichlorobenzene, 1,4-	5 Feb 2024	< 0.36	< 0.36	< 0.36	1, 5	ug/L	No
Dichloroethylene, 1,1-	5 Feb 2024	< 0.33	< 0.33	< 0.33	14	ug/L	No
Dichloroethane, 1,2-	5 Feb 2024	< 0.35	< 0.35	< 0.35	5	ug/L	No
Dichloromethane (Methylene Chloride)	5 Feb 2024	< 0.35	< 0.35	< 0.35	50	ug/L	No
Dichlorophenol, 2,4-	5 Feb 2024	< 0.15	< 0.15	< 0.15	0.3, 900	ug/L	No
Dichlorophenoxy acetic acid, 2,4- (2,4-D)	5 Feb 2024	< 0.19	< 0.19	< 0.19	100	ug/L	No
Diclofop-methyl	5 Feb 2024	< 0.40	< 0.40	< 0.40	9	ug/L	No
Dimethoate	5 Feb 2024	< 0.06	< 0.06	< 0.06	20	ug/L	No
Diquat	5 Feb 2024	< 1	< 1	< 1	70	ug/L	No
Diuron	5 Feb 2024	< 0.03	< 0.03	< 0.03	150	ug/L	No
Glyphosate	5 Feb 2024	< 1	< 1	< 1	280	ug/L	No

Malathion	5 Feb 2024	< 0.02	< 0.02	< 0.02	190	ug/L	No
MCPA	5 Feb 2024	< 0.00012	< 0.00012	< 0.00012	100	ug/L	No
Metolachlor	5 Feb 2024	< 0.01	< 0.01	< 0.01	50	ug/L	No
Metribuzin	5 Feb 2024	< 0.02	< 0.02	< 0.02	80	ug/L	No
Monochlorobenzene (Chlorobenzene)	5 Feb 2024	< 0.3	< 0.3	< 0.3	80	ug/L	No
Paraquat	5 Feb 2024	< 1	< 1	< 1	10	ug/L	No
Pentachlorophenol	5 Feb 2024	< 0.15	< 0.15	< 0.15	30, 60	ug/L	No
Phorate	5 Feb 2024	< 0.01	< 0.01	< 0.01	2	ug/L	No
Picloram	5 Feb 2024	< 1	< 1	< 1	190	ug/L	No
Poly-Chlorinated Biphenyls (PCB's)	5 Feb 2024	< 0.04	< 0.04	< 0.04	3	ug/L	No
Prometryne	5 Feb 2024	< 0.03	< 0.03	< 0.03	1	ug/L	No
Simazine	5 Feb 2024	< 0.01	< 0.01	< 0.01	10	ug/L	No
Terbufos	5 Feb 2024	< 0.01	< 0.01	< 0.01	1	ug/L	No
Tetrachloroethylene	5 Feb 2024	< 0.35	< 0.35	< 0.35	10	ug/L	No
Tetrachlorophenol, 2,3,4,6-	5 Feb 2024	< 0.20	< 0.20	< 0.20	1, 100	ug/L	No
Triallate	5 Feb 2024	< 0.01	< 0.01	< 0.01	230	ug/L	No
Trichloroethylene	5 Feb 2024	< 0.44	< 0.44	< 0.44	5	ug/L	No
Trichlorophenol 2,4,6-	5 Feb 2024	< 0.25	< 0.25	< 0.25	2, 5	ug/L	No
Trifluralin	5 Feb 2024	< 0.02	< 0.02	< 0.02	45	ug/L	No
Vinyl Chloride	5 Feb 2024	< 0.17	< 0.17	< 0.17	1	ug/L	No

**Table 9: Other Sampling Conducted Outside O. Reg. 170/03**

Parameter	Date Sampled	Result Well # 1	Result Well # 2/4	Result Well # 3	Unit
Chloride	9 Sep 2024	16	12	8.4	mg/L
Hardness	28 Aug 2019	294	296	289	mg/L

## Community Lead Testing Program

Historical low level lead sample results have qualified Clearview for the reduced sampling program under Schedule 15.1 of O. Reg. 170/03. Clearview is exempt from sampling private residences as less than 10% of plumbing samples exceeded the standard for two consecutive periods. Samples from the distribution system are collected during two sampling periods. Winter (Dec. 15 to Apr. 15) and Summer (June 15 to Oct. 15). Alkalinity and pH samples are analyzed in each sampling period, while lead is only required to be tested for every 3 years. Table 10 below summarizes the lead testing program sample results for the reporting period.

**Table 10: Schedule 15.1 - Lead**

Parameter	Number of Samples	Min	Max	ODWS MAC	Unit
Lead	0	-	-	0.010	mg/L
Alkalinity	6	212	252	30 - 500*	mg/L as CaCO <sub>3</sub>
pH	6	7.4	7.9	6.5 - 8.5*	-

\*Operational Guidelines

## Adverse Water Quality Incidents

There were four Adverse Water Quality Incidents (AWQIs) in 2024.

- AWQI number 164542 occurred on February 29, 2024. A bacteriological sample collected following a watermain repair on Sunnidale St. contained a total coliform count of 16. Corrective actions included the flushing of the sample location and collection of a set of resamples from the original location as well as upstream and downstream sites. All resample results were clear of contamination.
- AWQI number 164583 occurred on March 8, 2024. A bacteriological sample collected following a watermain repair on Sunnidale St. contained a total coliform count of 97. Corrective actions included the flushing of the sample location and collection of a set of resamples from the original location as well as upstream and downstream sites. All resample results were clear of contamination.
- AWQI number 167007 occurred on December 4, 2024. Two bacteriological samples collected following a watermain tie-in on Sunnidale St. contained total coliform counts of 21 and 7 respectively. Corrective actions for each location included the flushing of the sample location and collection of a set of resamples from the original location as well as upstream and downstream sites. Resample results from the original adverse locations were clear of contamination however, one of the downstream samples contained a total coliform and was reported as a new AWQI (details below).
- AWQI number 167022 occurred on December 6, 2024. A bacteriological sample collected at the Centre Line Rd. fire hydrant in response to AWQI 167007 contained a total coliform count of 1. Corrective action included flushing the sample location and a collection of a set of resamples from the original location and an upstream site. A downstream sample was not possible as this was the end of the watermain. All resample results were clear of contamination.

## **REGULATORY COMPLIANCE SUMMARY**

### **Safe Drinking Water Act & Associated Regulations**

No non-compliances were identified during this reporting period.

### **Municipal Drinking Water Licence & Drinking Water Works Permit**

No non-compliances were identified during this reporting period.

### **Permit to Take Water**

The instantaneous flow rate listed in the Permit to Take Water was exceeded on June 7<sup>th</sup> between 3:01 pm and 3:16 pm for both Well 1 and Well 3. A watermain break on the 300 mm diameter watermain near the pumphouses on Sunnidale St. resulted in the variable frequency drives on the well pumps being unable to properly control the discharge flow rates from each of the wells. The exceedances were reported to the local Ministry office.

### **Provincial Orders**

No provincial orders were issued during this reporting period.

# SYSTEM CAPACITY

## Allowable Capacities

Allowable capacities are imposed on the drinking water system by several legal instruments issued by the Ministry of Environment, Conservation and Parks. They are summarized in Table 11 below.


**Table 11: Allowable Capacities**

Instrument	Unit	Well # 1	Well # 2	Well # 3	Well # 4
Permit to Take Water	L/min	909	1,818	1,818	1,500
	m <sup>3</sup> /day	1,309	2,618	2,618	2,160
	Total from all wells m <sup>3</sup> /day	6,545 Wells 2 & 4 combined limited to 1,818 L/min and 2,618 m <sup>3</sup> /day			
Drinking Water Works Permit	L/sec	15.15	25	30.3	25
Municipal Drinking Water Licence	Total supplied to distribution system m <sup>3</sup> /day	1,309	2,619	2,619	2,160
		Well pumps 2 & 4 can be operated individually or simultaneously, however, the combined pumping capacity shall not exceed 2,619 m <sup>3</sup> /day.			

## 2024 Flow Summary

The table and charts below summarize the 2024 flow data for the Stayner drinking water system. This data is a general overview and can be utilized to analyze system performance and the potential need for upgrades.

**Figure 1: Monthly Flow Totals**

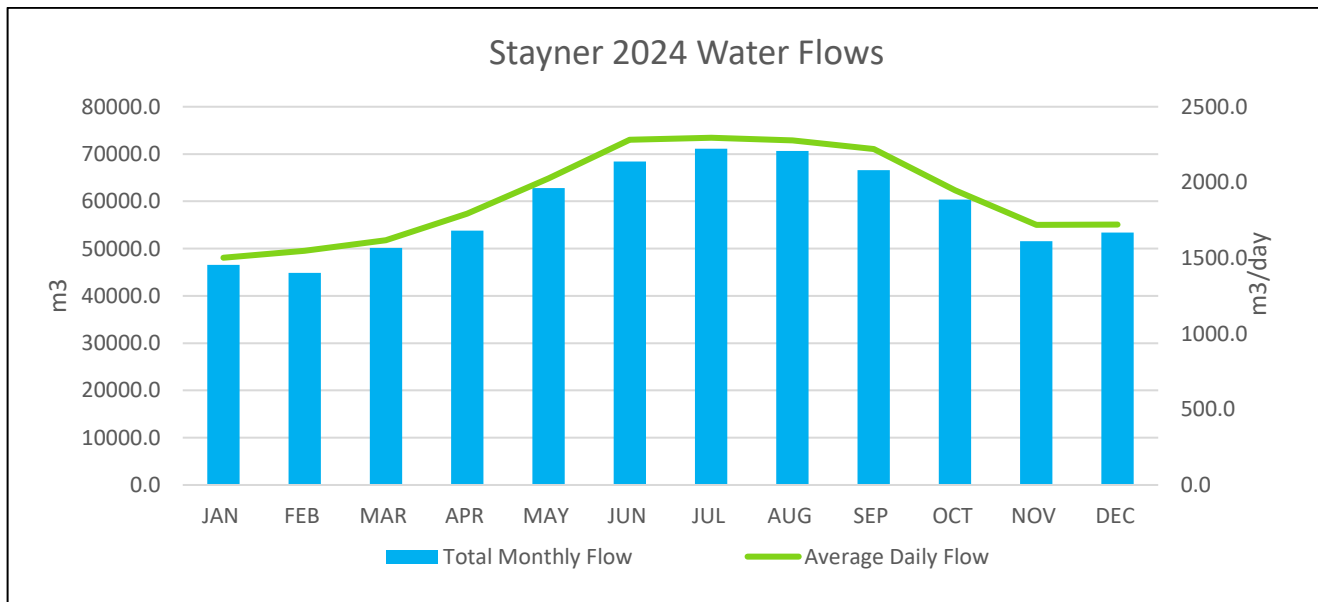


**Table 12: Monthly Flows**

2024	Total Flow m <sup>3</sup>	Average Daily Flow m <sup>3</sup> /d	Max Daily Flow m <sup>3</sup> /d	Firm Pumping Capacity m <sup>3</sup> /d	Actual Well Pumping Capacity m <sup>3</sup> /d	% Firm Capacity (MDD)	% Capacity (MDD)	Max 7-day average (PEAK WEEK) m <sup>3</sup> /d	% Firm Capacity PEAK WEEK	% Capacity PEAK WEEK
JAN	46562.3	1502.0	2768.8	3312.0	5760.0	83.6%	48.1%	1809.1	<b>54.6%</b>	31.4%
FEB	44871.1	1547.3	3457.6	3312.0	5760.0	104.4%	60.0%	1842.4	<b>55.6%</b>	32.0%
MAR	50124.3	1616.9	3029.3	3312.0	5760.0	91.5%	52.6%	1864.9	<b>56.3%</b>	32.4%
APR	53771.0	1792.4	2311.3	3312.0	5760.0	69.8%	40.1%	1927.3	<b>58.2%</b>	33.5%
MAY	62808.6	2026.1	2612.5	3312.0	5760.0	78.9%	45.4%	2137.8	<b>64.5%</b>	37.1%
JUN	68435.2	2281.2	3098.6	3312.0	5760.0	93.6%	53.8%	2560.3	<b>77.3%</b>	44.4%
JUL	71147.4	2295.1	2838.6	3312.0	5760.0	85.7%	49.3%	2412.3	<b>72.8%</b>	41.9%
AUG	70617.7	2278.0	3391.3	3312.0	5760.0	102.4%	58.9%	2647.0	<b>79.9%</b>	46.0%
SEP	66610.9	2220.4	2950.5	3312.0	5760.0	89.1%	51.2%	2624.2	<b>79.2%</b>	45.6%
OCT	60349.4	1946.8	2470.1	3312.0	5760.0	74.6%	42.9%	2173.9	<b>65.6%</b>	37.7%
NOV	51591.8	1719.7	2998.0	3312.0	5760.0	90.5%	52.0%	1907.3	<b>57.6%</b>	33.1%
DEC	53375.7	1721.8	3817.6	3312.0	5760.0	115.3%	66.3%	2057.7	<b>62.1%</b>	35.7%
<b>Total/ Yr.</b>	<b>700265.3</b>	<b>1918.5</b>	<b>3817.6</b>							


Note: All capacity values used are based on actual pump outputs and flow rates. Firm pumping capacity is the available flow with the largest pump out of service.

**Figure 2: System Capacity**

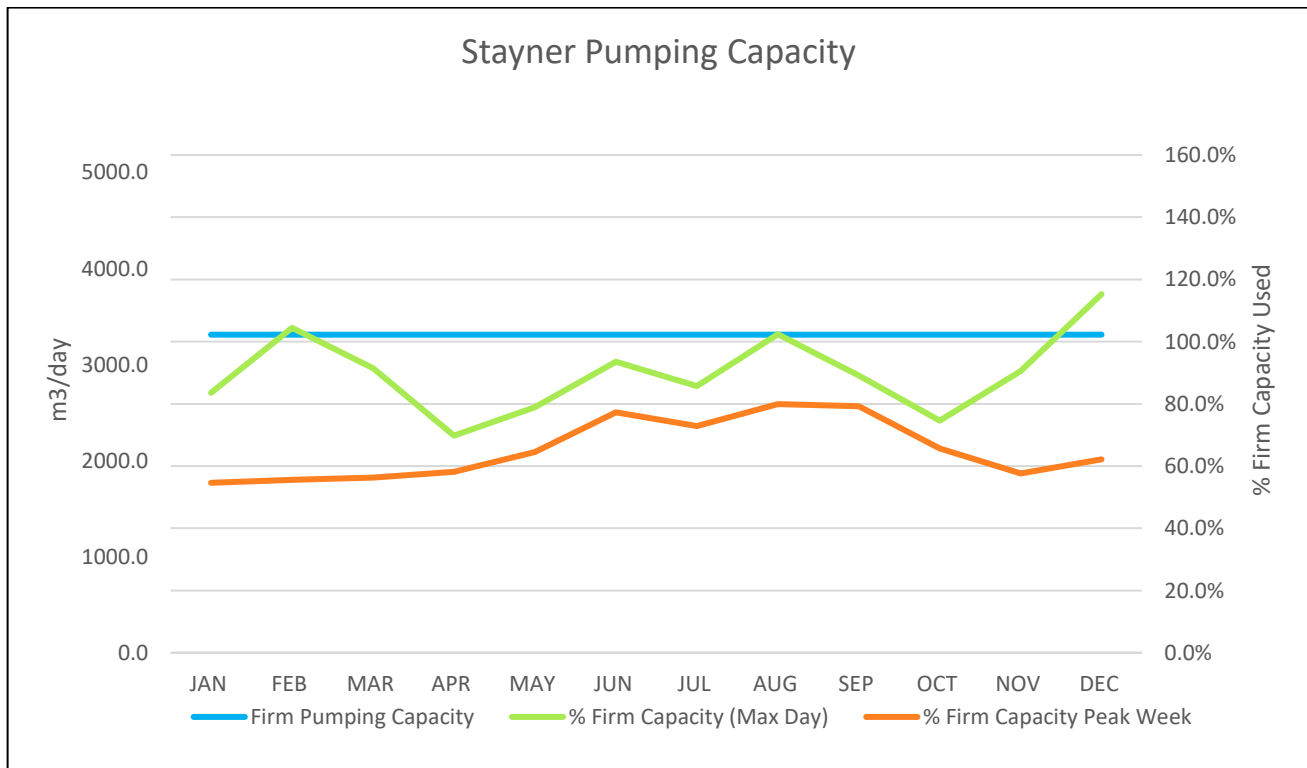

In 2024, the day with the largest volume of water produced was December 3<sup>rd</sup> with 3,817 m<sup>3</sup>. The peak week (where reservoir capacity is being used to average out peak daily flows) occurred between August 22<sup>nd</sup> and August 28<sup>th</sup> with an average of 2,647 m<sup>3</sup>/day of water being produced. Figure 3 below depicts the total daily raw water flow and treated water flow for the system.

**Figure 3: 2024 Daily Flows**

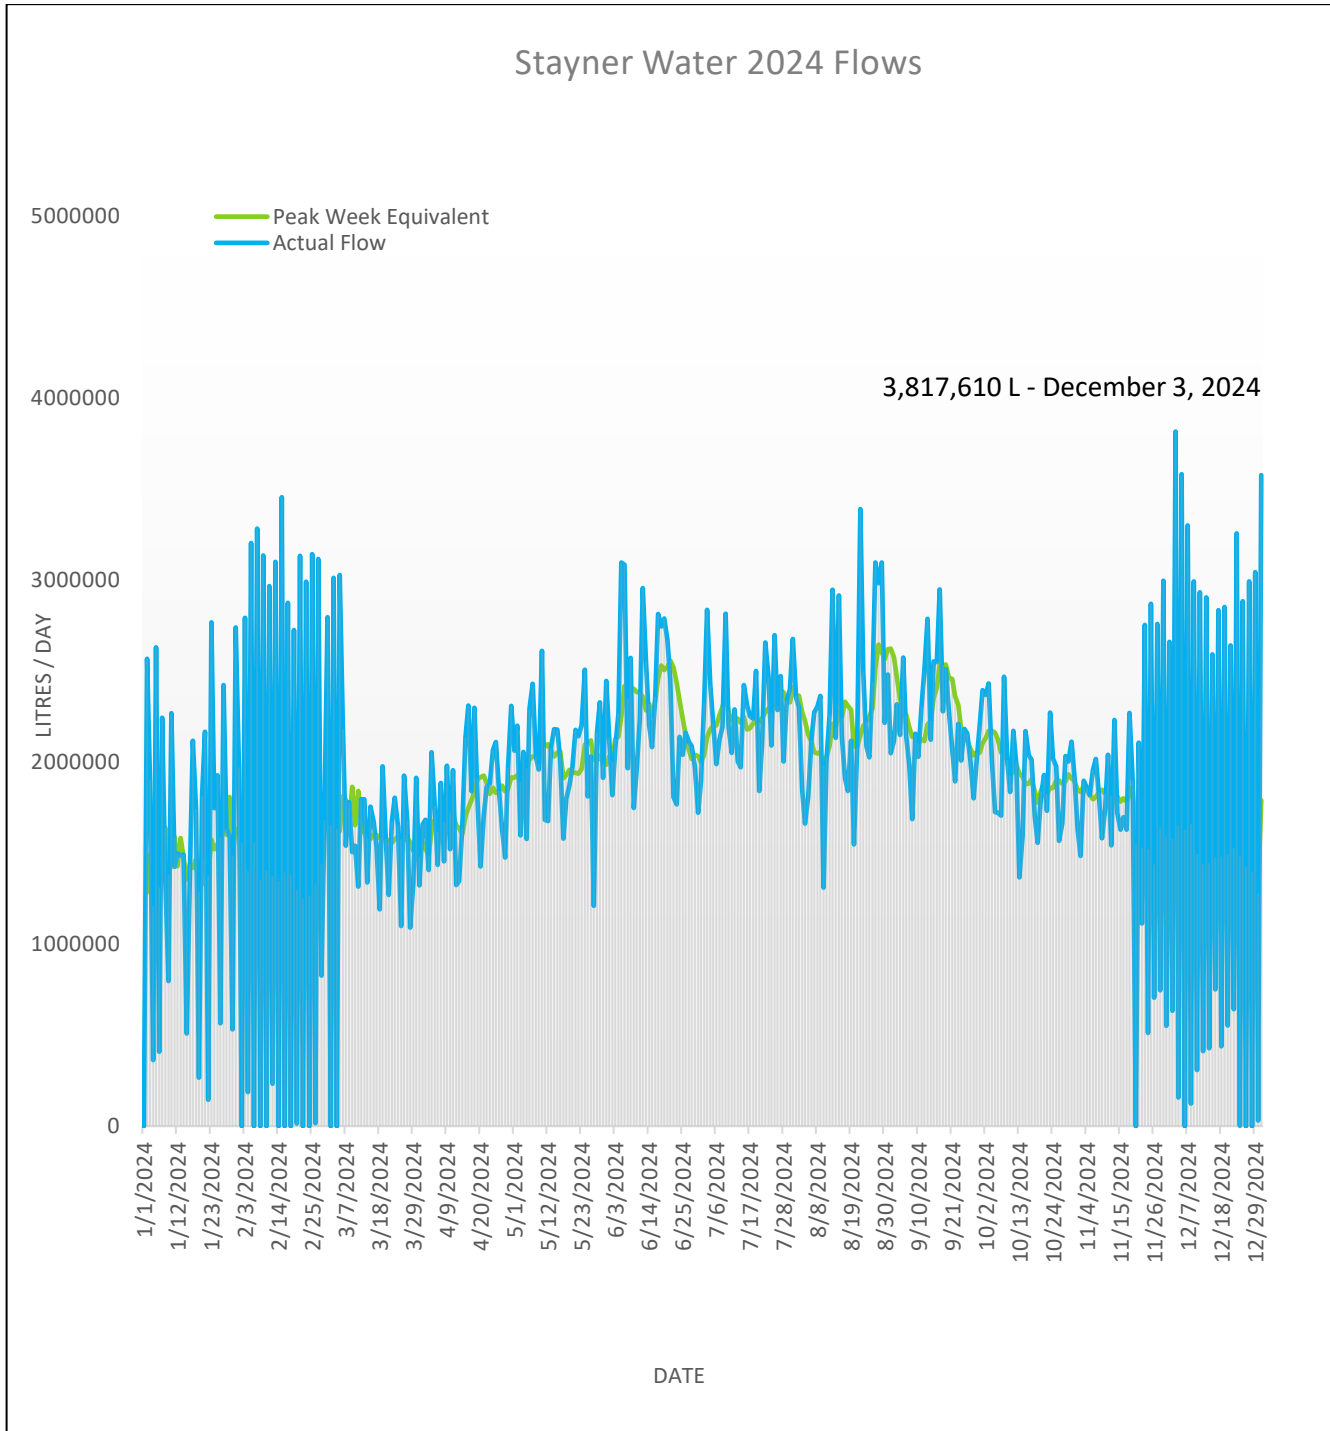

Following a below average total annual flow year in 2023, water usage in 2024 rose by 4.95%, matching the water volume produced in 2022. This increase was observed across all types of water system users. The single large industrial user that is the system’s biggest consumer saw their water consumption increase by 8.95% compared to 2023 volumes, accounting for about one third of the total water produced in 2024. Excluding this user, the remaining customers showed a 3.12% increase in flow compared to the previous year. Figure 4 below, shows the total annual flow trend for the drinking water system over the last five years.

**Figure 4: Five-year Total Flow Comparison**

